


Curves

Bed expansion

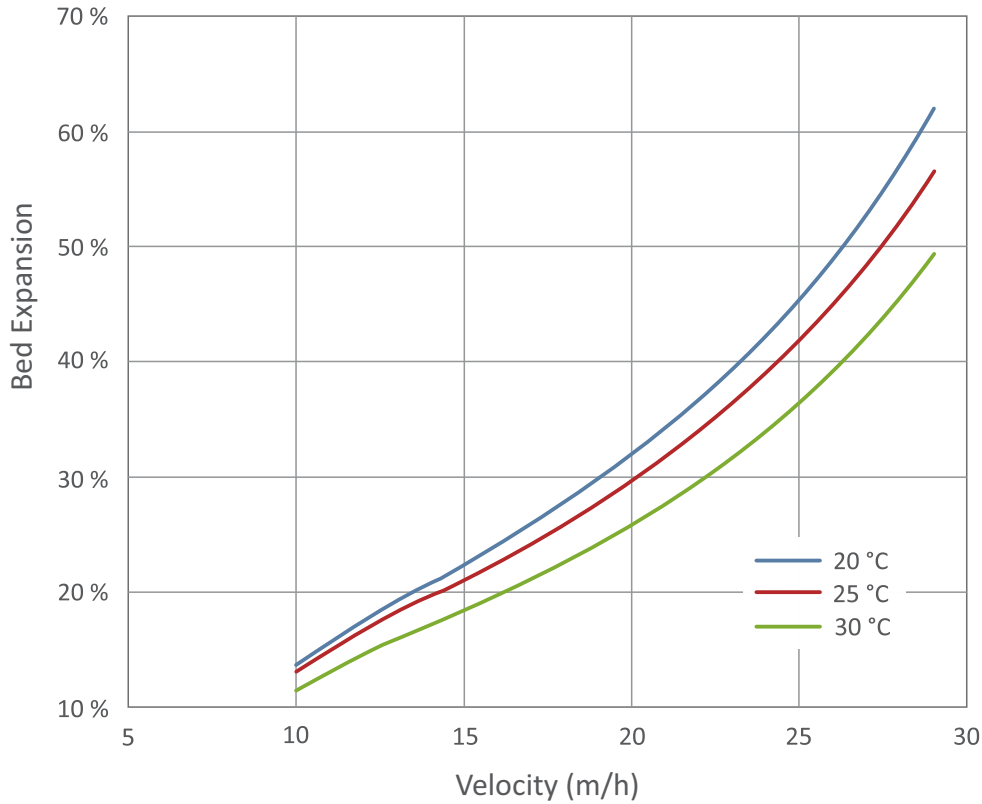

Pressure drop

The pressure drop of a filter system with TITANSORB® is the result of the accumulated pressure drops caused by all components of the system. The typical pressure drop caused by TITANSORB® is 0.5 a 1.5 PSI per foot of bed depth within the recommended operating conditions for the product.